
USER'S MANUAL



KSB K2 EC



Centrifugal duct fan in sound insulated casing

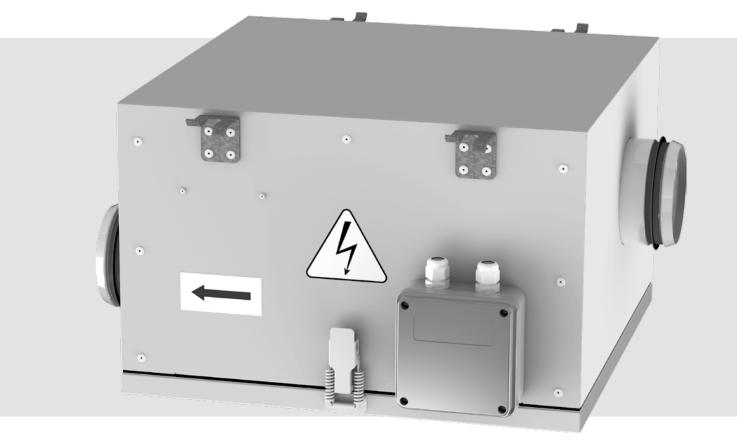





CONTENTS

Safety requirements	.2
Safety requirements Purpose	.4
Delivery set	.4
Designation key	.4
Delivery set Designation key Technical data	.5
Unit design and operating principle	.6
Installation and connection	6
Connection to power mains	.8
Connection to power mains Control Technical maintenance Troubleshooting	.8
Technical maintenance	.9
Troubleshooting	.9
Storage and transportation regulations Manufacturer's warranty Certificate of acceptance	.9
Manufacturer's warranty	.10
Certificate of acceptance	.11
Seller information	.11
Installation certificate	.11
Installation certificate Warranty card	.11

This user's manual is a main operating document intended for technical, maintenance, and operating staff.

The manual contains information about purpose, technical details, operating principle, design, and installation of the KSB K2 EC unit and all its modifications.

Technical and maintenance staff must have theoretical and practical training in the field of ventilation systems and should be able to work in accordance with workplace safety rules as well as construction norms and standards applicable in the territory of the country. The information in this user's manual is correct at the time of the document's preparation.

The Company reserves the right to modify the technical characteristics, design, or configuration of its products at any time in order to incorporate the latest technological developments.

No part of this publication may be reproduced, stored in a retrieval system, or transmitted, in any form or by any means in any information search system or translated into any language in any form without the prior written permission of the Company.

SAFETY REQUIREMENTS

- Please read the user's manual carefully prior to installing and operating the unit.
- All user's manual requirements as well as the provisions of all the applicable local and national construction, electrical, and technical norms and standards must be observed when installing and operating the unit.
- The warnings contained in the user's manual must be considered most seriously since they contain vital personal safety information.
- Failure to follow the rules and safety precautions noted in this user's manual may result in an injury or unit damage.
- After a careful reading of the manual, keep it for the entire service life of the unit.
- While transferring the unit control, the user's manual must be turned over to the receiving operator.

UNIT INSTALLATION AND OPERATION SAFETY PRECAUTIONS



Disconnect the unit from power mains prior to any installation operations.



The unit must be grounded!



• Unpack the unit with care.



While installing the unit, follow the safety regulations specific to the use of electric tools.







- Do not lay the power cable of the unit in close proximity to heating equipment.
- Do not operate the unit outside the temperature range stated in the user's manual. Do not operate the unit in aggressive or explosive environments.
- Do not wash the unit with water. Protect the electric parts of the unit against ingress of water.
- Disconnect the unit from power mains prior to any technical maintenance.
- When the unit generates unusual sounds, odour, or emits smoke, disconnect it from power supply and contact the Seller.
- Do not direct the air flow produced by the unit towards open flame or ignition sources.
- In case of continuous operation of the unit, periodically check the security of mounting.
- Use the unit only for its intended purpose.



THE PRODUCT MUST BE DISPOSED SEPARATELY AT THE END OF ITS SERVICE LIFE. DO NOT DISPOSE THE UNIT AS UNSORTED MUNICIPAL WASTE.





PURPOSE

THE UNIT SHOULD NOT BE OPERATED BY CHILDREN OR PERSONS WITH REDUCED PHYSICAL, MENTAL, OR SENSORY CAPACITIES, OR THOSE WITHOUT THE APPROPRIATE TRAINING. THE UNIT MUST BE INSTALLED AND CONNECTED ONLY BY PROPERLY QUALIFIED PERSONNEL AFTER THE APPROPRIATE BRIEFING. THE CHOICE OF UNIT INSTALLATION LOCATION MUST PREVENT UNAUTHORIZED ACCESS BY UNATTENDED CHILDREN.

The centrifugal fan in a sound insulated casing is designed for supply and exhaust ventilation of domestic, public and industrial premises with high requirements to the noise level and with limited space for mounting.

The unit is rated for continuous operation.

The unit is a component part and is not designed for stand-alone operation.

Transported air must not contain any flammable or explosive mixtures, evaporation of chemicals, sticky substances, fibrous materials, coarse dust, soot and oil particles or environments favourable for the formation of hazardous substances (toxic substances, dust, pathogenic germs).

DELIVERY SET

NAME	NUMBER
Fan	1 pc.
User's manual	1 pc.
Packing box	1 pc.

DESIGNATION KEY

Designation example: KSB 100 K2 EC Q R1
Centrifugal duct fan in sound insulated casing
Spigot connecting diameter [mm]
Casing modification
Motor type _ — asynchronous EC — electronically commutated
Motor options S — high-powered motor Q — low-noise and low-power motor
Connection options remote terminal box R — power cord with an IEC C14 connector R1 — power cord with a plug R2 — power cord with a British plug







TECHNICAL DATA

The unit is rated as a Class I electrical appliance.

	KSB 100 K2 EC	KSB 125 K2 EC	KSB 150 K2 EC	KSB 160 K2 EC	KSB 200 K2 EC	KSB 250 K2 EC	KSB 315 K2 EC	KSB 355 K2 EC	KSB 400 K2 EC	KSB 450 K2 EC	KSB 500 K2 EC
Unit voltage [V/50 (60) Hz]	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230	1~ 230
Power [W]	69	78	81	85	111	164	531	527	513	1200	752
Current [A]	0.55	0.58	0.59	0.60	0.88	1.32	2.32	2.31	2.25	1.95	3.42
Maximum air flow [m³/h]	341	444	495	454	740	1099	3053	3417	3633	5620	7145
RPM [min ⁻¹]	3270	3270	3270	3600	2400	2800	2360	2360	2360	2580	1440
Sound pressure level at 3 m distance [dBA]	37	39	40	40	42	45	47	50	51	54	56
Transported air temperature [°C]	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55	-25+55
Ingress protection rating	IPX4										
SEC class	ErP 2018										

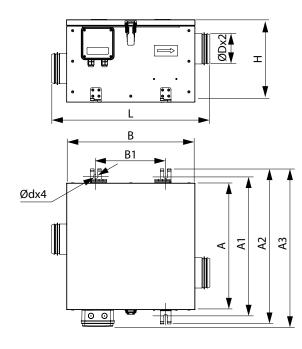



Madal	Overall and connecting dimensions of the fan [mm]								Weinhe flend		
Model	D	н	L	А	A1	A2	A3	В	B1	d	Weight [kg]
KSB 100 K2 EC	99	270	517	414	458	507	515	420	228		12
KSB 125 K2 EC	124	270	517	414	458	507	515	420	228		12
KSB 150 K2 EC	149	270	517	414	458	507	515	420	228	14	12
KSB 160 K2 EC	159	270	517	414	458	507	515	420	228	14	12
KSB 200 K2 EC	198	328	648	553	597	645,5	654	551	374		20
KSB 250 K2 EC	248	371	762	616	660	709	717	665	487		27
KSB 315 K2 EC	313	505	904	737	790	818	832	807	600		47
KSB 355 K 2EC	354	505	904	737	790	818	832	807	600		47
KSB 400 K2 EC	399	505	904	737	790	818	832	807	600	9	47
KSB 450 K2 EC	449	580	982	805	858	886	900	885	670		60
KSB 500 K2 EC	499	660	1146	998	1051	1079	1094	1049	800		86






UNIT DESIGN AND OPERATING PRINCIPLE

The fan casing is made of aluzinc. For easy installation and operation, the top cover of the fan is secured with a special lock. The casing is heat- and sound-insulated with a 50 mm layer of non-flammable mineral wool. To ensure better noise absorption, the inner surface of the insulation is made of a perforated metal sheet. The round connecting spigots are rubber sealed.

The fan is equipped with an electronically commutated motor with an external rotor and an impeller with backward curved blades. The low-noise motor with ball bearings with specially selected grease ensures maintenance-free operation of the fan.

Duct fans are intended for mounting to round air ducts. The fans are installed between the air ducts. In case the fan is mounted on flexible joints, attach the fan to a structural unit by means of supports, suspension links or brackets (purchased separately). The fan may be installed in any position in consideration of the air flow direction (as indicated by the arrow on the fan casing).

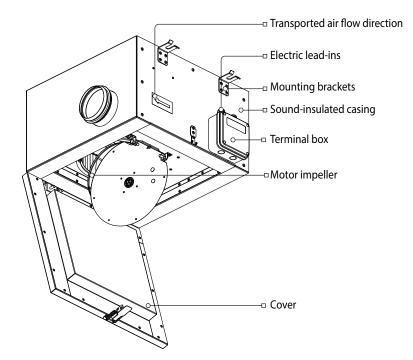

INSTALLATION AND CONNECTION

WHILE INSTALLING THE UNIT ENSURE CONVENIENT ACCESS FOR SUBSEQUENT MAINTENANCE AND REPAIR.



THE UNIT MUST BE MOUNTED ON A PLANE SURFACE.


MOUNTING OF THE UNIT TO AN UNEVEN SURFACE CAN LEAD TO THE UNIT CASING DISTORTION AND OPERATION DISTURBANCE.

- Before installing the fan, make sure the casing has no visible damages and check the integrity of power supply wires. The fan casing must not contain any foreign objects which can damage the impeller blades.
- Make sure the impeller rotates freely without touching the flange and the casing.
- Mount the fan in such a way that the arrow on the fan casing matches the air flow direction in the system.
- The casing has mounting brackets to facilitate the fan installation.
- The fan may be installed in any position in consideration of the air flow direction (as indicated by the arrow on the fan casing).
- To attain the best performance of the fan and to minimize turbulence-induced air pressure losses while mounting, connect the straight air duct section to the fan spigots on both sides of the fan. The minimum straight air duct length is equal to 1 air duct diameter on the intake side and 3 air duct diameters on the exhaust side. No filters or any other similar devices are allowed to be installed in these sections.




® //ENT5


1. Mark the holes for mounting the fan.




3. Fix the fan on the mounting brackets using the appropriate fasteners.




5. Unscrew the terminal box cover.

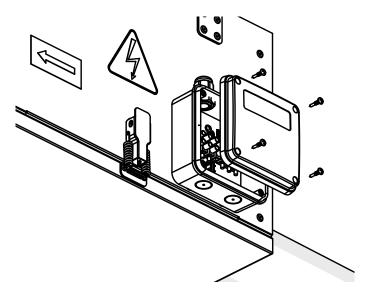

2. Drill the holes according to the markings.




4. Connect the air ducts (purchased separately) to the fan spigots.

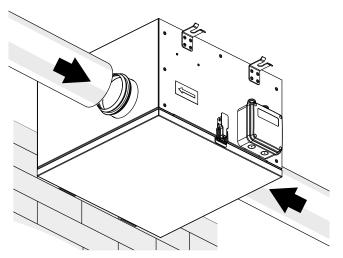

6. Make the electrical connections in compliance with the wiring diagram.

Re-assemble the terminal box in the reverse order.

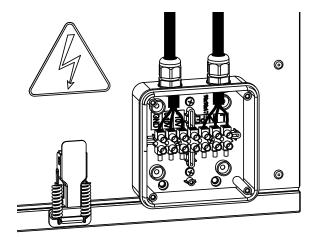






CONNECTION TO POWER MAINS

DISCONNECT THE UNIT FROM POWER MAINS PRIOR TO ANY OPERATIONS. THE UNIT MUST BE CONNECTED TO POWER MAINS BY A QUALIFIED ELECTRICIAN. THE RATED ELECTRICAL PARAMETERS OF THE UNIT ARE SHOWN ON THE RATING PLATE.

- The unit is rated for connection to 220-240 V/50 (60) Hz power mains.
- The unit must be connected to power mains using insulated electric conductors (cables, wires). The actual wire cross section selection
 must be based on the maximum load current, maximum conductor temperature depending on the wire type, insulation, length and
 installation method.
- The external power input must be equipped with an automatic circuit breaker built into the stationary wiring to open the electric circuit in case of overload or short-circuit. The circuit breaker installation place must provide quick access for emergency shutdown of the unit. The trip current of the automatic circuit breaker QF must exceed the maximum current consumption of the unit (refer to the technical data table). The recommended trip current of the circuit breaker is the next current in the standard trip current row following the maximum current of the connected unit. Automatic circuit breaker is not included in the delivery set.

Connection of the fan to power mains and to additional external control units is carried out in the control box on the fan casing. External speed control devices must provide voltage from 0 to 10 V at the motor input or PWM signal with an amplitude of 10 V. External control units are purchased separately (shown in dotted lines in the diagram).



CONTROL

Additional external control units can be connected to the fan for speed control. The fan speed control can be either smooth or stepped.





TECHNICAL MAINTENANCE



DISCONNECT THE UNIT FROM POWER SUPPLY BEFORE ANY MAINTENANCE OPERATIONS!

The technical maintenance includes periodic cleaning of the surfaces from accumulated dust and dirt. The impeller blades require thorough cleaning once in 6 months. Clean the blades with a soft brush or a vacuum cleaner. While cleaning the fan be careful not to displace the impeller counter weights. Protect the electric motor against ingress of liquid.



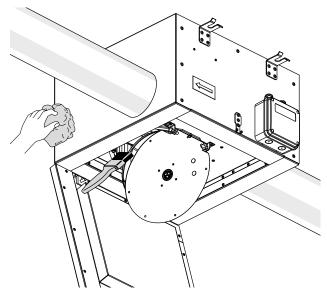

TROUBLESHOOTING

PROBLEM	POSSIBLE REASONS	TROUBLESHOOTING		
The fan does not start.	No power supply.	Make sure that the unit is properly connected to the power mains and make any corrections, if necessary.		
Low air flow.	The ventilation system is soiled or damaged.	Make sure the air ducts are clean and intact. Clean them necessary.		
Neise vibration	The fan impeller is soiled.	Clean the impellers.		
Noise, vibration.	The screw connection is loose.	Tighten the fastening screws.		

STORAGE AND TRANSPORTATION REGULATIONS

- Store the unit in the manufacturer's original packaging box in a dry closed ventilated premise with temperature range up +5 °C to +40 °C and relative humidity up to 70 %.
- Storage environment must not contain aggressive vapours and chemical mixtures provoking corrosion, insulation, and sealing deformation.
- Use suitable hoist machinery for handling and storage operations to prevent possible damage to the unit.
- Follow the handling requirements applicable for the particular type of cargo.
- The unit can be carried in the original packaging by any mode of transport provided proper protection against precipitation and mechanical damage. The unit must be transported only in the working position.
- Avoid sharp blows, scratches, or rough handling during loading and unloading.
- Prior to the initial power-up after transportation at low temperatures allow the unit to warm up at room temperature for at least 3-4 hours.





MANUFACTURER'S WARRANTY

The product is in compliance with EU norms and standards on low voltage guidelines and electromagnetic compatibility. We hereby declare that the product complies with the provisions of Electromagnetic Council Directive 2014/30/EU, Low Voltage Directive 2014/35/EU and CE-marking Directive 93/68/EEC. This certificate is issued following test carried out on samples of the product referred to above. The manufacturer hereby warrants normal operation of the unit for 24 months after the retail sale date provided the user's observance of the transportation, storage, installation, and operation regulations. Should any malfunctions occur in the course of the unit operation through the Manufacturer's fault during the guaranteed period of operation, the user is entitled to get all the faults eliminated by the manufacturer by means of warranty repair at the factory free of charge. The warranty repair includes work specific to elimination of faults in the unit operation to ensure its intended use by the user within the guaranteed period of operation. The faults are eliminated by means of replacement or repair of the unit components or a specific part of such unit component.

The warranty repair does not include:

- routine technical maintenance
- unit installation/dismantling
- unit setup

To benefit from warranty repair, the user must provide the unit, the user's manual with the purchase date stamp, and the payment paperwork certifying the purchase. The unit model must comply with the one stated in the user's manual. Contact the Seller for warranty service.

The manufacturer's warranty does not apply to the following cases:

- User's failure to submit the unit with the entire delivery package as stated in the user's manual including submission with missing component parts previously dismounted by the user.
- Mismatch of the unit model and the brand name with the information stated on the unit packaging and in the user's manual.
- User's failure to ensure timely technical maintenance of the unit.
- External damage to the unit casing (excluding external modifications as required for installation) and internal components caused by the user.
- Redesign or engineering changes to the unit.
- Replacement and use of any assemblies, parts and components not approved by the manufacturer.
- Unit misuse.
- Violation of the unit installation regulations by the user.
- Violation of the unit control regulations by the user.
- Unit connection to power mains with a voltage different from the one stated in the user's manual.
- Unit breakdown due to voltage surges in power mains.
- Discretionary repair of the unit by the user.
- Unit repair by any persons without the manufacturer's authorization.
- Expiration of the unit warranty period.
- Violation of the unit transportation regulations by the user.
- Violation of the unit storage regulations by the user.
- Wrongful actions against the unit committed by third parties.
- Unit breakdown due to circumstances of insuperable force (fire, flood, earthquake, war, hostilities of any kind, blockades).
- Missing seals if provided by the user's manual.
- Failure to submit the user's manual with the unit purchase date stamp.
- Missing payment paperwork certifying the unit purchase.



FOLLOWING THE REGULATIONS STIPULATED HEREIN WILL ENSURE A LONG AND TROUBLE-FREE OPERATION OF THE UNIT.



USER'S WARRANTY CLAIMS SHALL BE SUBJECT TO REVIEW ONLY UPON PRESENTATION OF THE UNIT, THE PAYMENT DOCUMENT AND THE USER'S MANUAL WITH THE PURCHASE DATE STAMP.






CERTIFICATE OF ACCEPTANCE

Unit Type	Centrifugal duct fan in sound insulated casing						
Model	KSB K2 EC						
Serial Number							
Manufacture Date							
Quality Inspector's Stamp							

SELLER INFORMATION

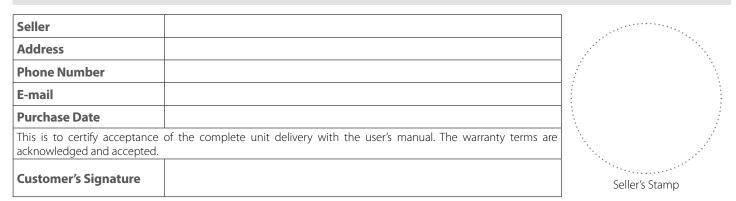

INSTALLATION CERTIFICATE

The KSB K2 E0 stated in the present user's r	cted to power mains pursuant to t	he requirements	
Seller			
Address			
Phone Number			
Installation Technician's Full Name			N. Z
Installation Date:	Signature:		
	sions of all the applicable local and nat perates normally as intended by the ma		Installation Company Stamp
Signature:			

WARRANTY CARD

Unit Type	Centrifugal duct fan in sound insulated casing	
Model	KSB K2 EC	
Serial Number		
Manufacture Date		
Purchase Date		
Warranty Period		
Seller		Seller's Stamp





Μιχαήλ Καραολή 19, τκ 143 43, Ν. Χαλκηδόνα, Αθήνα Τηλ: 211 - 70.55.500 & 210 - 21.30.051, Fax: 210 - 22.23.283



V143-2EN-01